


SECTION "A-A"

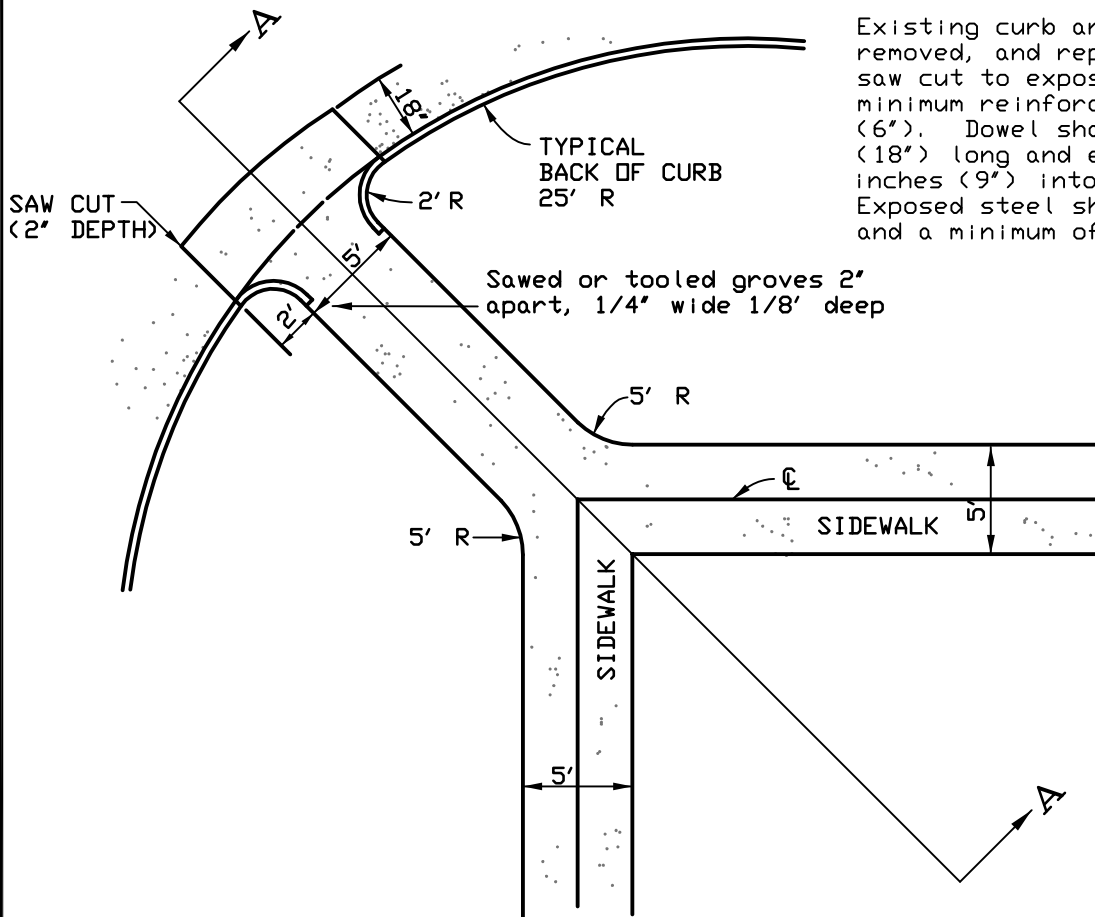

Existing curb and gutter to be saw cut, removed, and replaced. Dowel steel or saw cut to expose existing steel for minimum reinforcing overlap of six inches (6"). Dowel shall be eighteen inches (18") long and embedded a minimum of nine inches (9") into existing pavement. Exposed steel shall be in good condition and a minimum of nine (9") long.

THE CITY OF ROSENBERG, FORT BEND COUNTY, TEXAS
DEPARTMENT OF PUBLIC WORKS

SIDEWALK RAMP

DESIGN:	CAD:	SCALE:	DATE:	DRAWING:
CAK	STAFF	NTS	12/10	P-110a